

## Description


Ope - Jamb

### Identifier

2.21

### NSAI modeller no.

TM/02

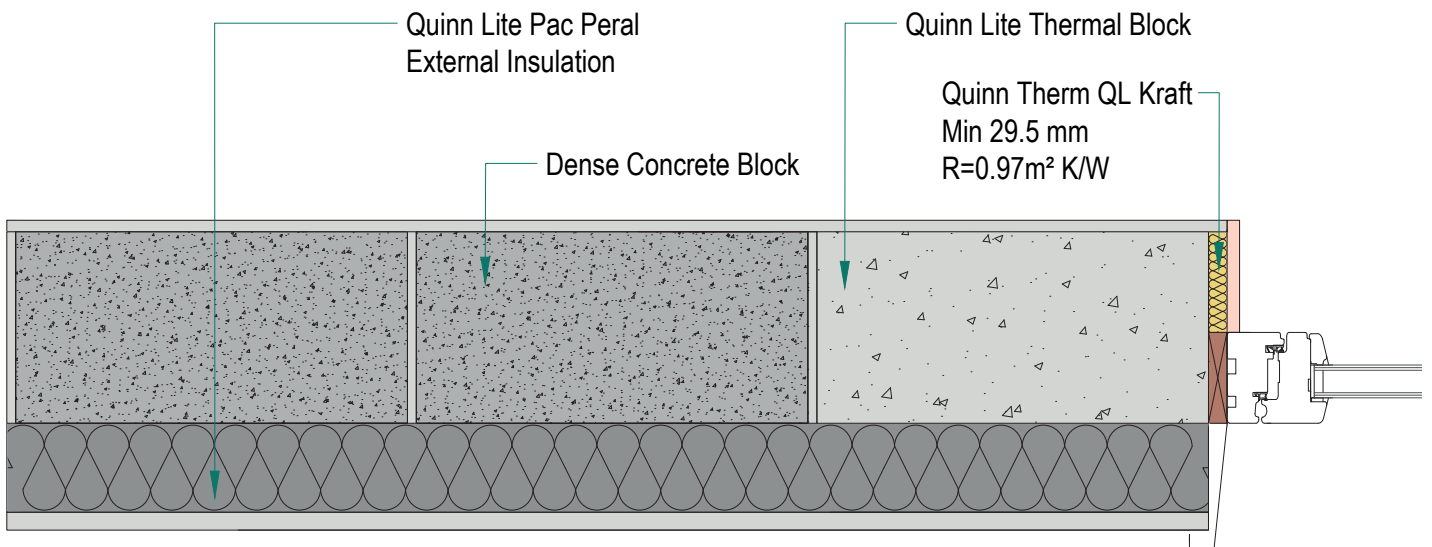

	A		B		C	
	Wall U-value 0.21W/m2K Roof = 0.16, Floor = 0.21		Wall U-value 0.15W/m2K Roof = 0.14, Floor = 0.15		Wall U-value 0.12W/m2K Roof = 0.12, Floor = 0.12	
Inner leaf type	Ψ-value (W/mK)	Temperature factor (fRsi)	Ψ-value (W/mK)	Temperature factor (fRsi)	Ψ-value (W/mK)	Temperature factor (fRsi)
B3	-0.037	0.94	-0.013	0.96	-0.002	0.97
B5	-0.024	0.94	-0.005	0.96	0.006	0.97
B7	-0.021	0.94	-0.002	0.96	0.008	0.96

## Notes

Ensure external wall insulation with a min. R-value of 0.97 m2K/W overlaps the window frame



**NSAI**  
Agrément

Andrew Lundberg  
Passivate

Registration Number IAB/TM/02  
NSAI Approved Thermal Modeller