

## Description


Open - Jamb Detail

### Identifier

6.20

### NSAI modeller no.

TM/02

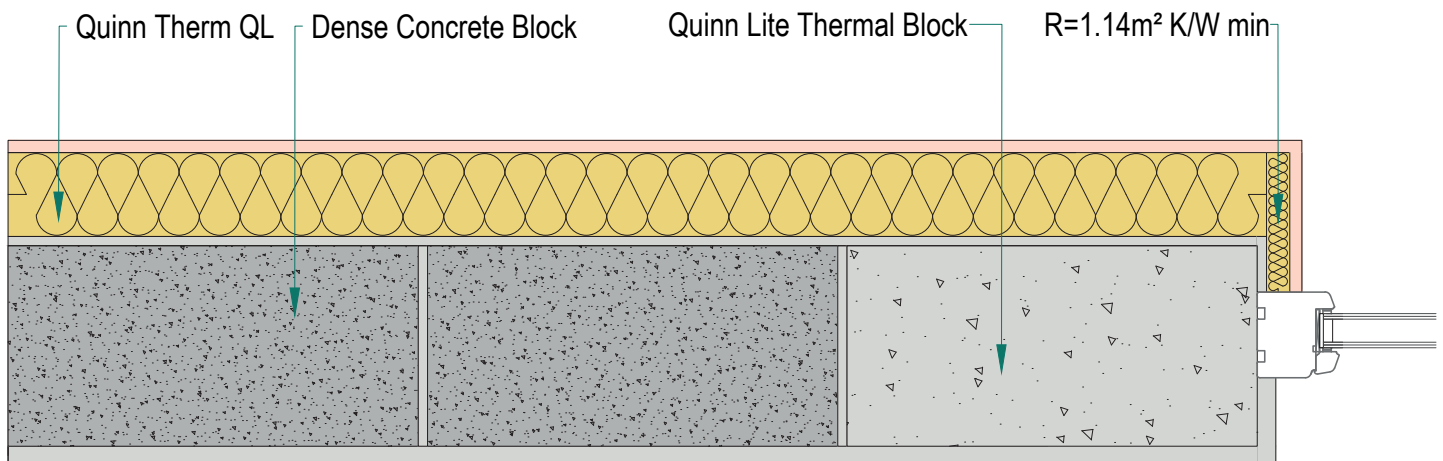

	A		B		C	
	Wall U-value 0.21W/m <sup>2</sup> K (internal insulation only) Roof = 0.16, Floor = 0.21		Wall U-value 0.15W/m <sup>2</sup> K (internal insulation only) Roof = 0.14, Floor = 0.15		Wall U-value 0.12W/m <sup>2</sup> K (internal insulation only) Roof = 0.12, Floor = 0.12	
Inner leaf type	Ψ-value (W/mK)	Temperature factor (fRsi)	Ψ-value (W/mK)	Temperature factor (fRsi)	Ψ-value (W/mK)	Temperature factor (fRsi)
B3	-0.003	0.91	0.012	0.91	0.027	0.91
B5	0.007	0.90	0.020	0.90	0.030	0.90
B7	0.010	0.90	0.022	0.89	0.032	0.89

## Notes

Install insulation to jamb with a minimum R-value of 1.14 m<sup>2</sup>K/W. Inside of Window frame to be positioned no greater than 40mm from internal face of hollow block.



Andrew Lundberg  
Passivate  
Registration Number IAB/TM/02  
NSAI Approved Thermal Modeller